


FRAME: HLA-4X-10

REVDATE: 0424

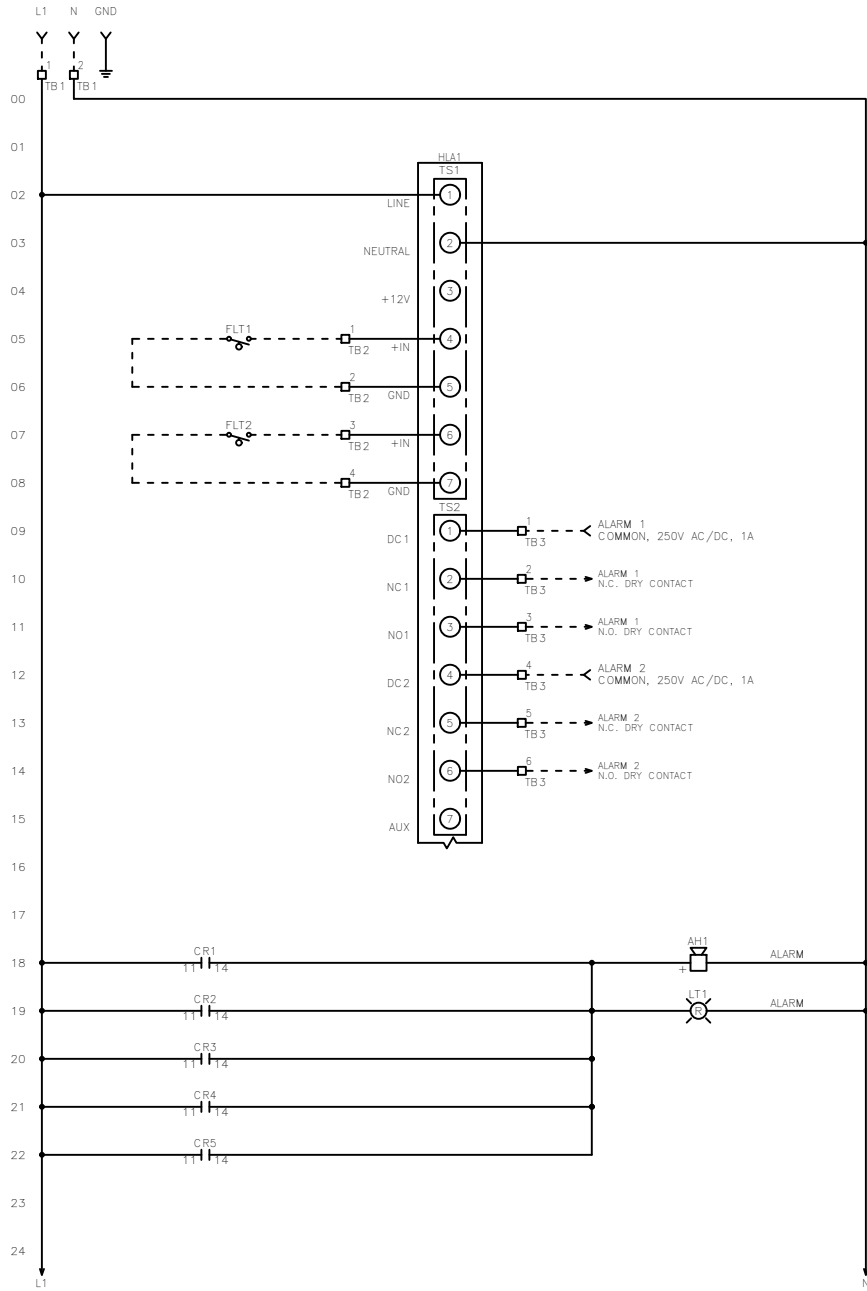

NOTES:

- S4 SUFFIX INDICATES ALL FLOATS ARE NORMALLY CLOSED FLOATS.
- 32 SUFFIX INDICATES CUSTOM LABELING THAT MAY DIFFER FROM THE STANDARD LABELING AND/OR NORMALLY OPEN AND NORMALLY CLOSED MAY DIFFER FROM DRAWING ABOVE.


DASHED LINE INDICATES
FIELD WIRING.

USE COPPER CONDUCTORS ONLY.

TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).


BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER. MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

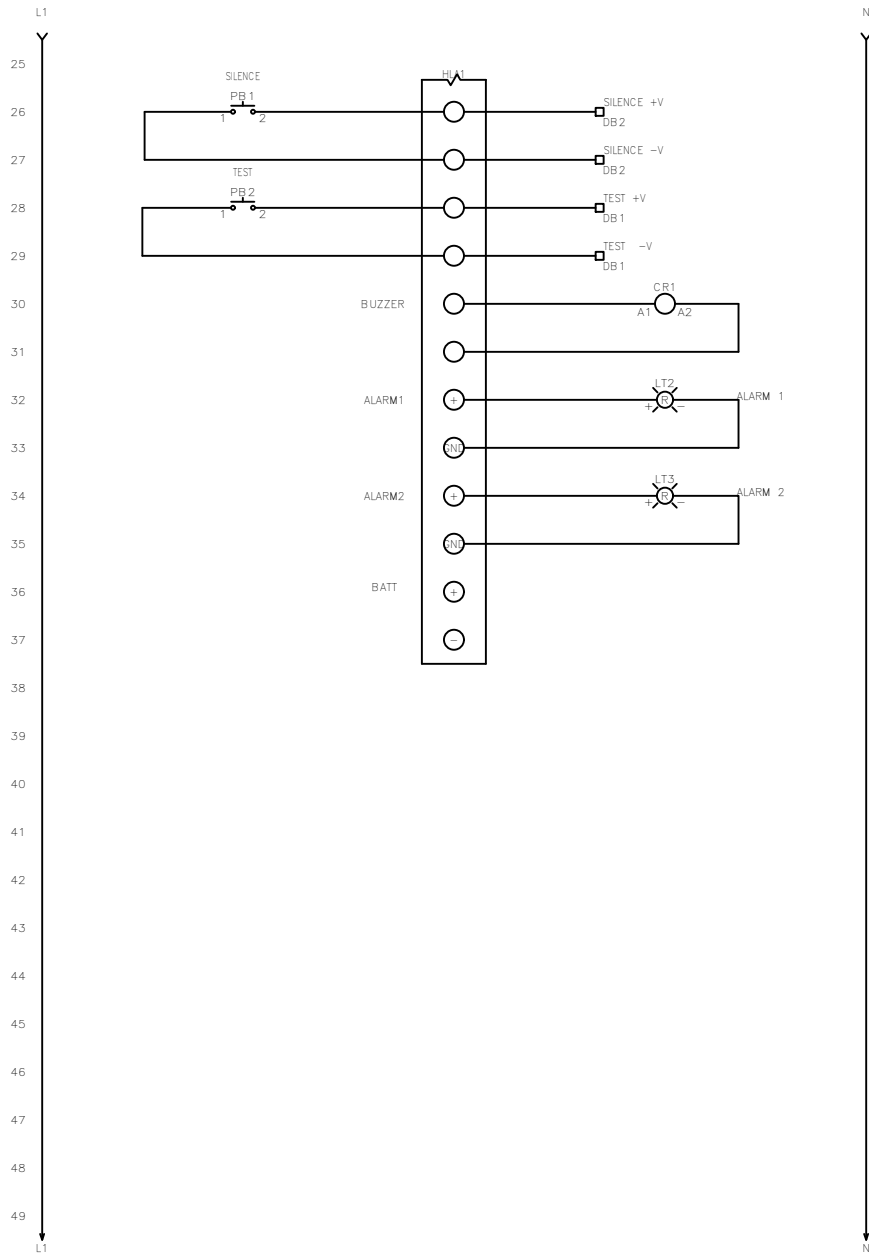

DRAWN BY:		DATE:			
MM		07/23/16			
APPROVED BY:		DATE:		TITLE:	
DO		04/10/24			
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.		HLA-4X-10 CONTROL SCHEMATIC			
		SIZE	DWG. NO.	PART NO.	REV
		B	1596	HLA-4X-10	D
SCALE		NONE	SHEET		1 OF 6



REVDATE: 0424

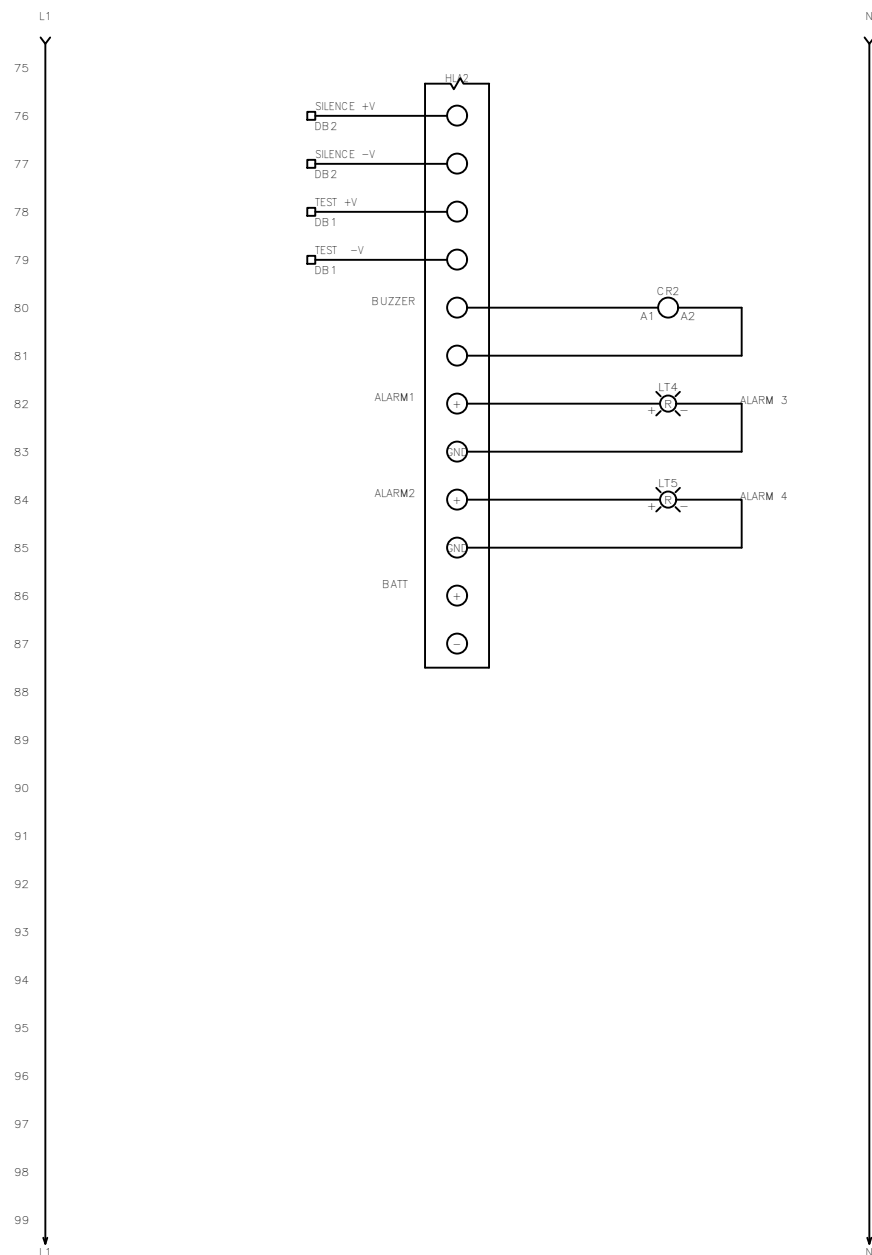

DRAWN BY: <div>MM</div>	DATE: <div>07/23/16</div>				
APPROVED BY: <div>DO</div>	DATE: <div>04/10/24</div>	TITLE: <div>HLA-4X-10 CONTROL SCHEMATIC</div>			
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.		SIZE <div>B</div>	DWG NO. <div>1596</div>	PART NO. <div>HLA-4X-10</div>	REV <div>D</div>
		SCALE <div>NONE</div>	SHEET <div>2 OF 6</div>		

FNAME: HLA-4X-10

REVDATE: 0424

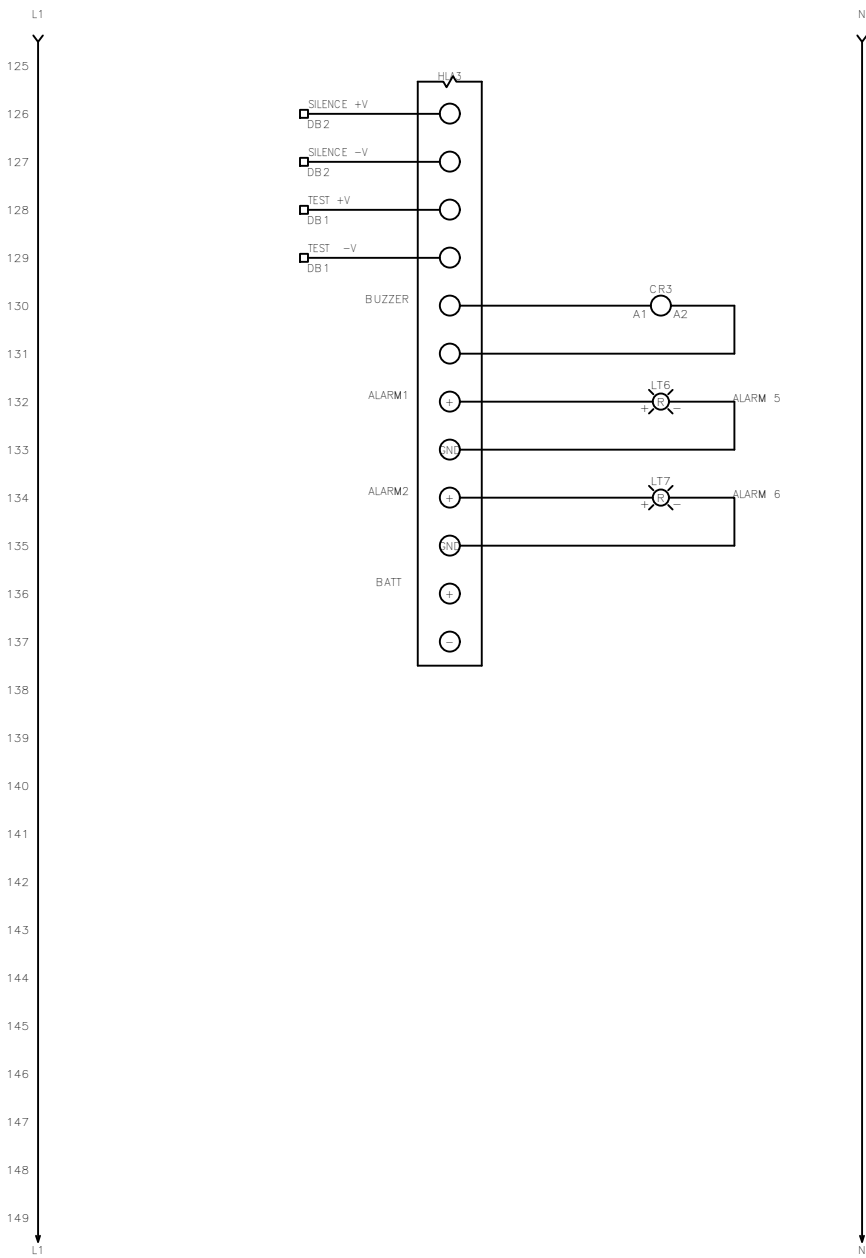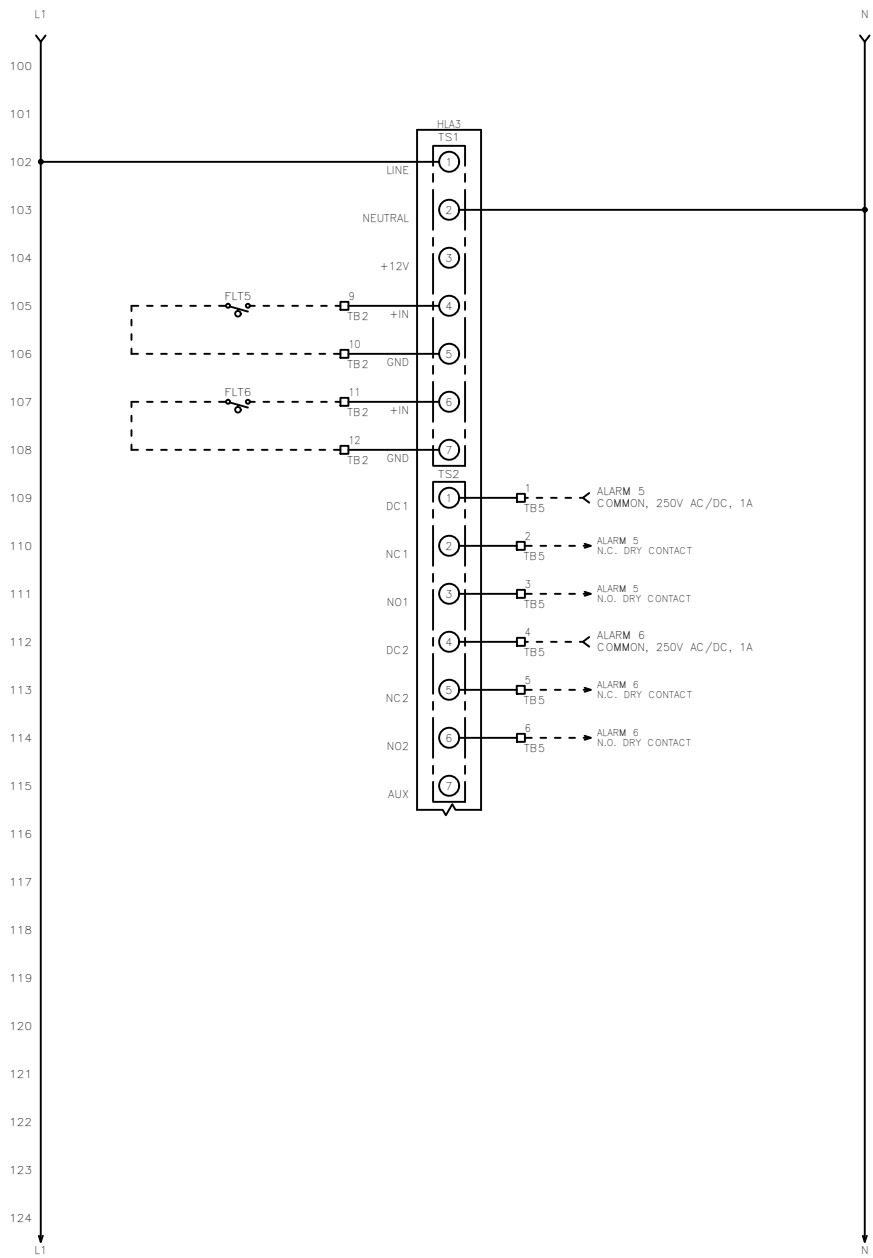

NOTES:

-S4 SUFFIX INDICATES ALL FLOATS ARE NORMALLY CLOSED FLOATS.

-32 SUFFIX INDICATES CUSTOM LABELING THAT MAY DIFFER FROM THE STANDARD LABELING AND/OR NORMALLY OPEN AND NORMALLY CLOSED MAY DIFFER FROM DRAWING ABOVE.

DASHED LINE INDICATES FIELD WIRING.

USE COPPER CONDUCTORS ONLY.

TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).



BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER. MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

DRAWN BY:		DATE:					
MM		07/23/16					
APPROVED BY:		DATE:		TITLE: HLA-4X-10 CONTROL SCHEMATIC			
DO		04/10/24					
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.							
				SIZE	DWG NO.	PART NO.	REV
				B	1596	HLA-4X-10	D
SCALE		NONE	SHEET		3 OF 6		

FNAME: HLA-4X-10

REVDATE: 0424

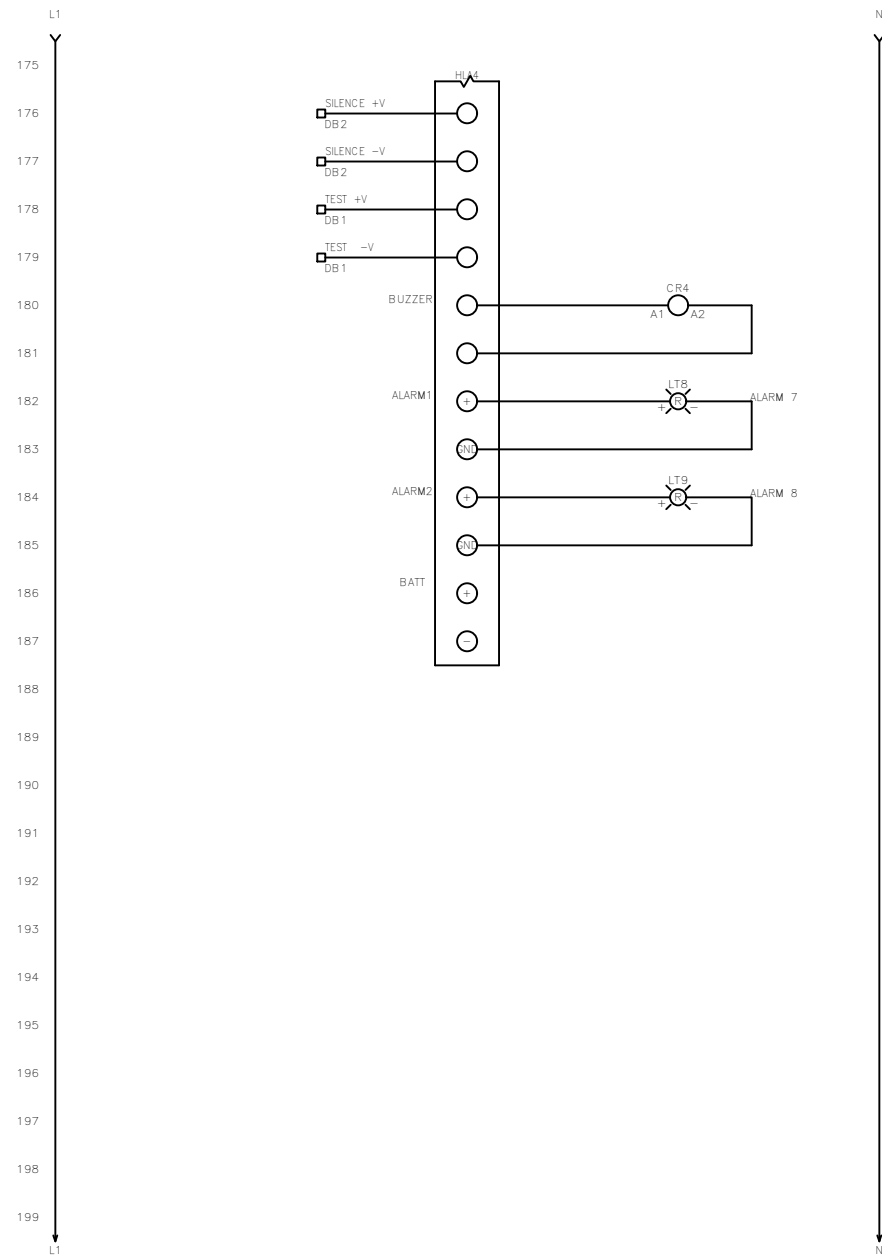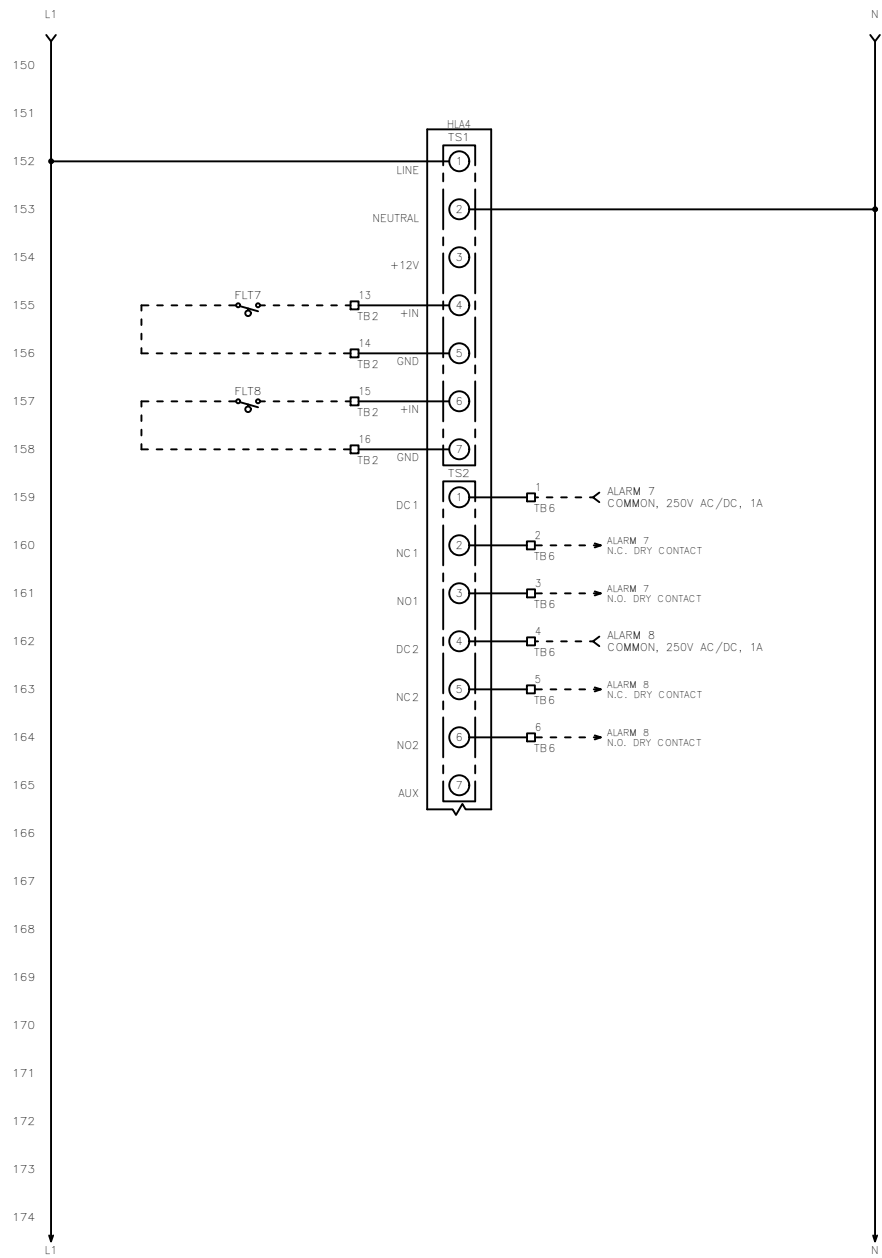

NOTES:

-S4 SUFFIX INDICATES ALL FLOATS ARE NORMALLY CLOSED FLOATS.

-32 SUFFIX INDICATES CUSTOM LABELING THAT MAY DIFFER FROM THE STANDARD LABELING AND/OR NORMALLY OPEN AND NORMALLY CLOSED MAY DIFFER FROM DRAWING ABOVE.

----- DASHED LINE INDICATES FIELD WIRING.

USE COPPER CONDUCTORS ONLY.


TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).

BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER. MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

DRAWN BY:		DATE:					
MM		07/23/16					
APPROVED BY:		DATE:		TITLE: HLA-4X-10 CONTROL SCHEMATIC			
DO		04/10/24					
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.							
				SIZE	DWG NO.	PART NO.	REV
				B	1596	HLA-4X-10	D
SCALE		NONE	SHEET		4 OF 6		

REVDATE: 0424

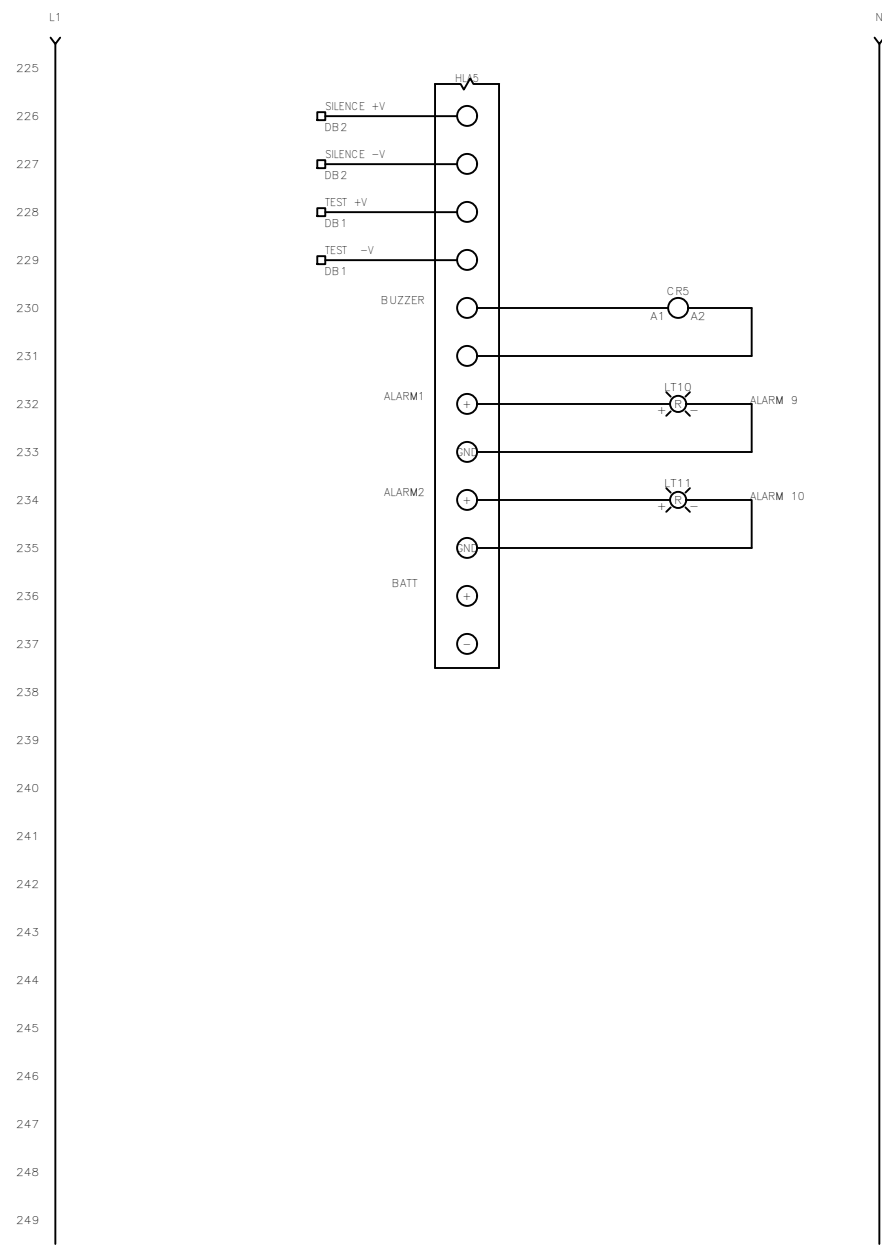


DRAWN BY:		DATE:				
MM		07/23/16				
APPROVED BY:		DATE:		TITLE:		
DO		04/10/24				
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.		HLA-4X-10 CONTROL SCHEMATIC				
		SIZE	DWG NO.	PART NO.	REV	
		B	1596	HLA-4X-10	D	
		SCALE	NONE		SHEET	5 OF 6

FNAME: HLA-4X-10

REVDATE: 0424

FIELD WIRING CONNECTIONS

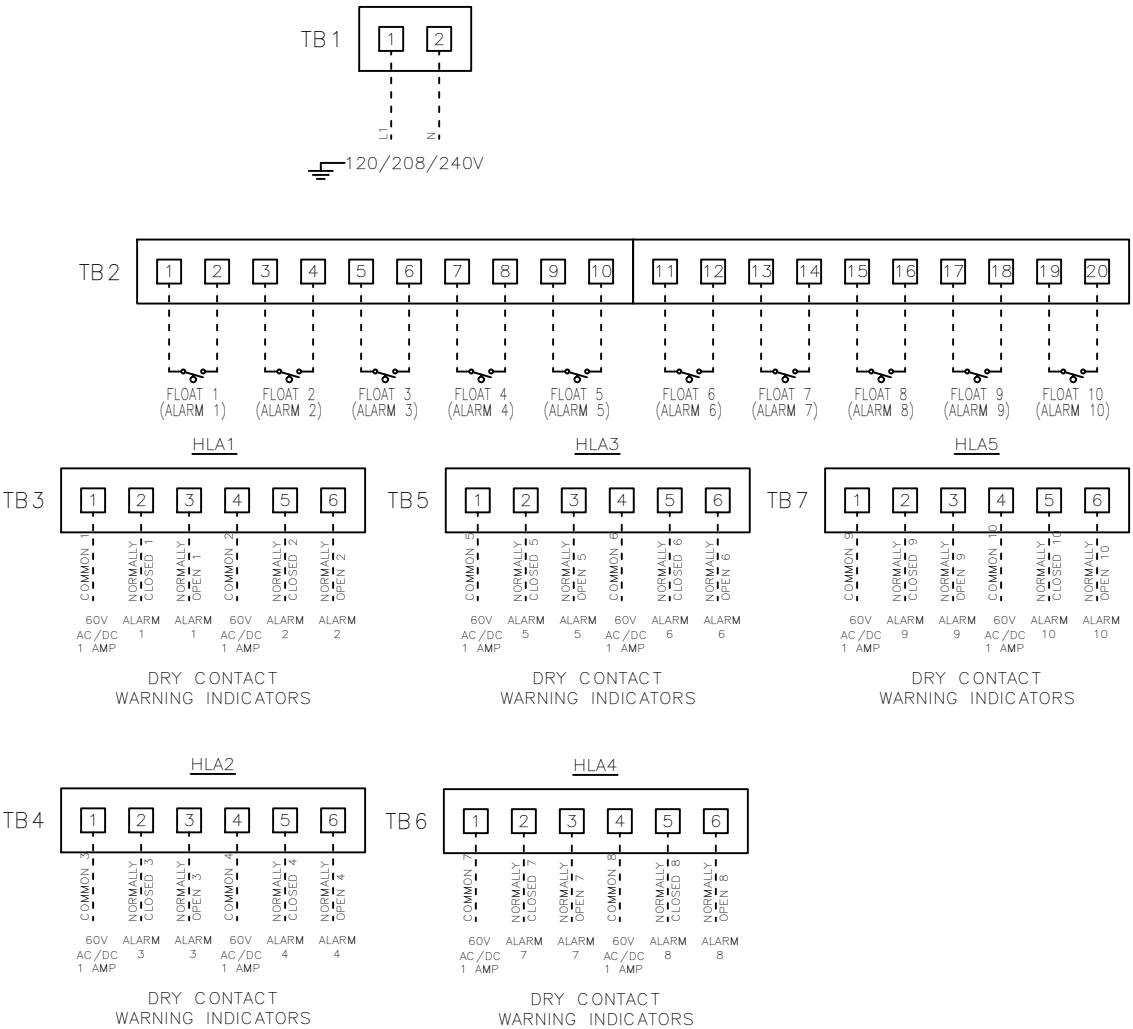

NOTES:

-S4 SUFFIX INDICATES ALL FLOATS ARE NORMALLY CLOSED FLOATS.

-32 SUFFIX INDICATES CUSTOM LABELING THAT MAY DIFFER FROM THE STANDARD LABELING AND/OR NORMALLY OPEN AND NORMALLY CLOSED MAY DIFFER FROM DRAWING ABOVE.

----- DASHED LINE INDICATES FIELD WIRING.

USE COPPER CONDUCTORS ONLY.

TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).

BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER. MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

DRAWN BY:		DATE:					
MM		07/23/16					
APPROVED BY:		DATE:		TITLE: HLA-4X-10 CONTROL SCHEMATIC			
DO		04/10/24					
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.				SIZE	DWG NO.	PART NO.	REV
				B	1596	HLA-4X-10	D
				SCALE	NONE		SHEET