
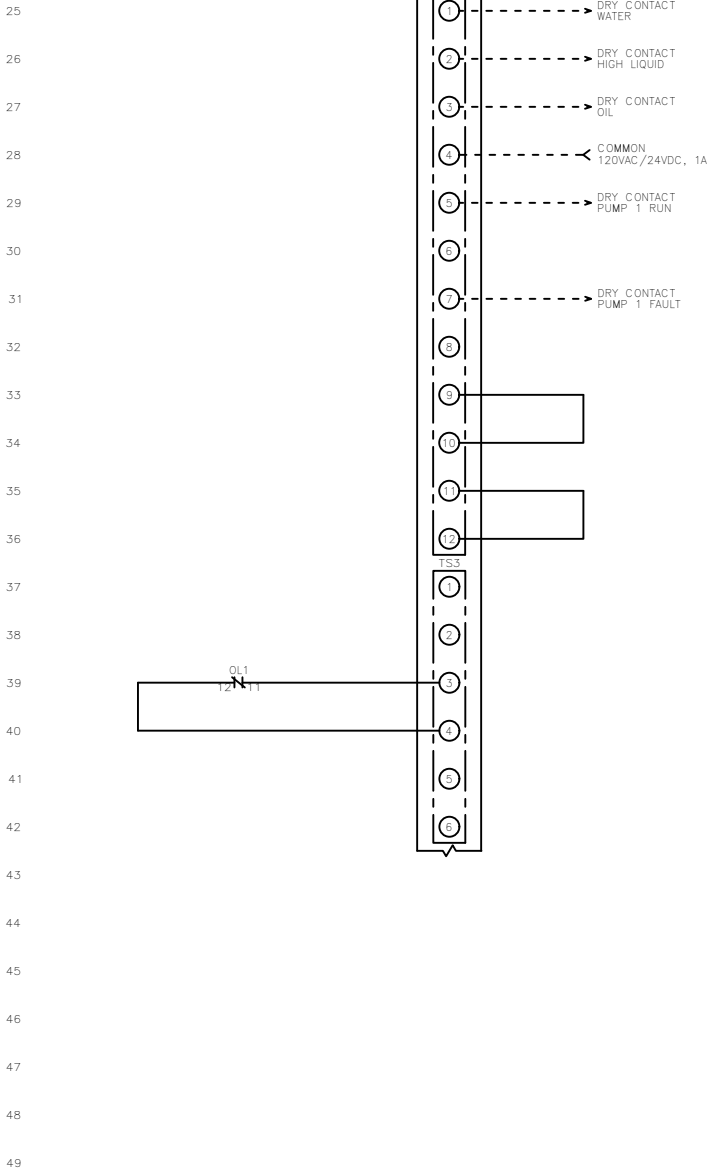


FNAME: OSSIM-TP-(1001-1004)

REVDATE: 0524

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	M	UPDATED DRY CONTACTS	5/24/24	AC

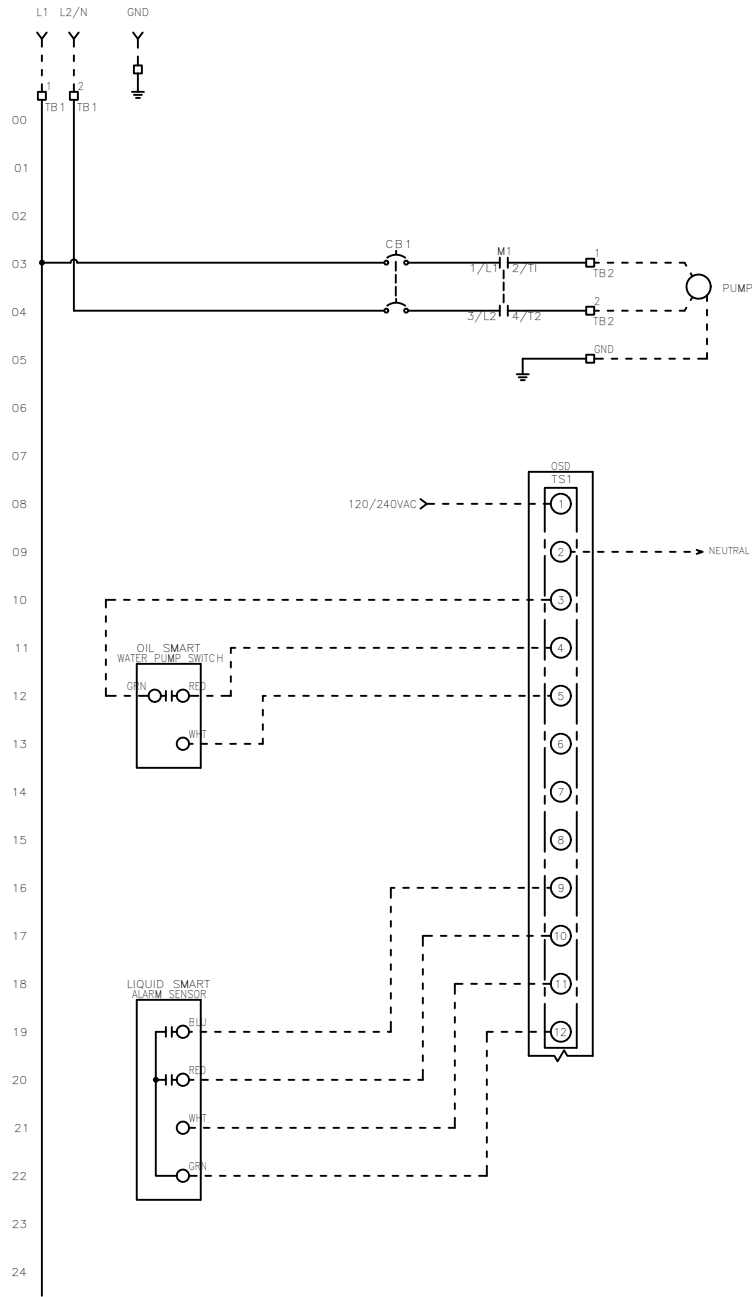

----- DASHED LINE INDICATES FIELD WIRING.

USE COPPER CONDUCTORS ONLY.

TEMPERATURE RATING OF CONDUCTORS IS TO BE:
60°C (140°F) FOR UNDER 100A.
75°C (167°F) FOR OVER 100A.

BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER. MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

FIELD WIRING TORQUE SPECS.		DRAWN BY:	DATE:				
TERMINAL BLOCK UT 2,5	5 IN-LB	MM	7/15/22				
TERMINAL BLOCK UT 4	7 IN-LB	APPROVED BY:	DATE:	TITLE: OSSIM-TP-(1001-1004) CONTROL SCHEMATIC			
TERMINAL BLOCK UT 6	15 IN-LB						
TERMINAL BLOCK UT 10	15 IN-LB						
TERMINAL BLOCK UT 16	25 IN-LB						
TERMINAL BLOCK UT 35	30 IN-LB						
TS1, TS2, J2 & J3 PCB	5 IN-LB						
TRANSFORMER H1F, H2F & H3F	15 IN-LB						
TRANSFORMER H1, H2 & H3	10 IN-LB						
DS1 VLS3P16-63 R1	16 IN-LB						
DS1 VLS3P63-125 R2	45 IN-LB						
DS1 LK4JU3CN 100A	36 IN-LB						
DS1 LK4MU3N 200A	200 IN-LB						
		THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.		SIZE	DWG NO.	PART NO.	REV
				B	1512	OSSIM-TP-(1001-1004)	M
				SCALE	NONE		SHEET 1 OF 2

[illegible]