
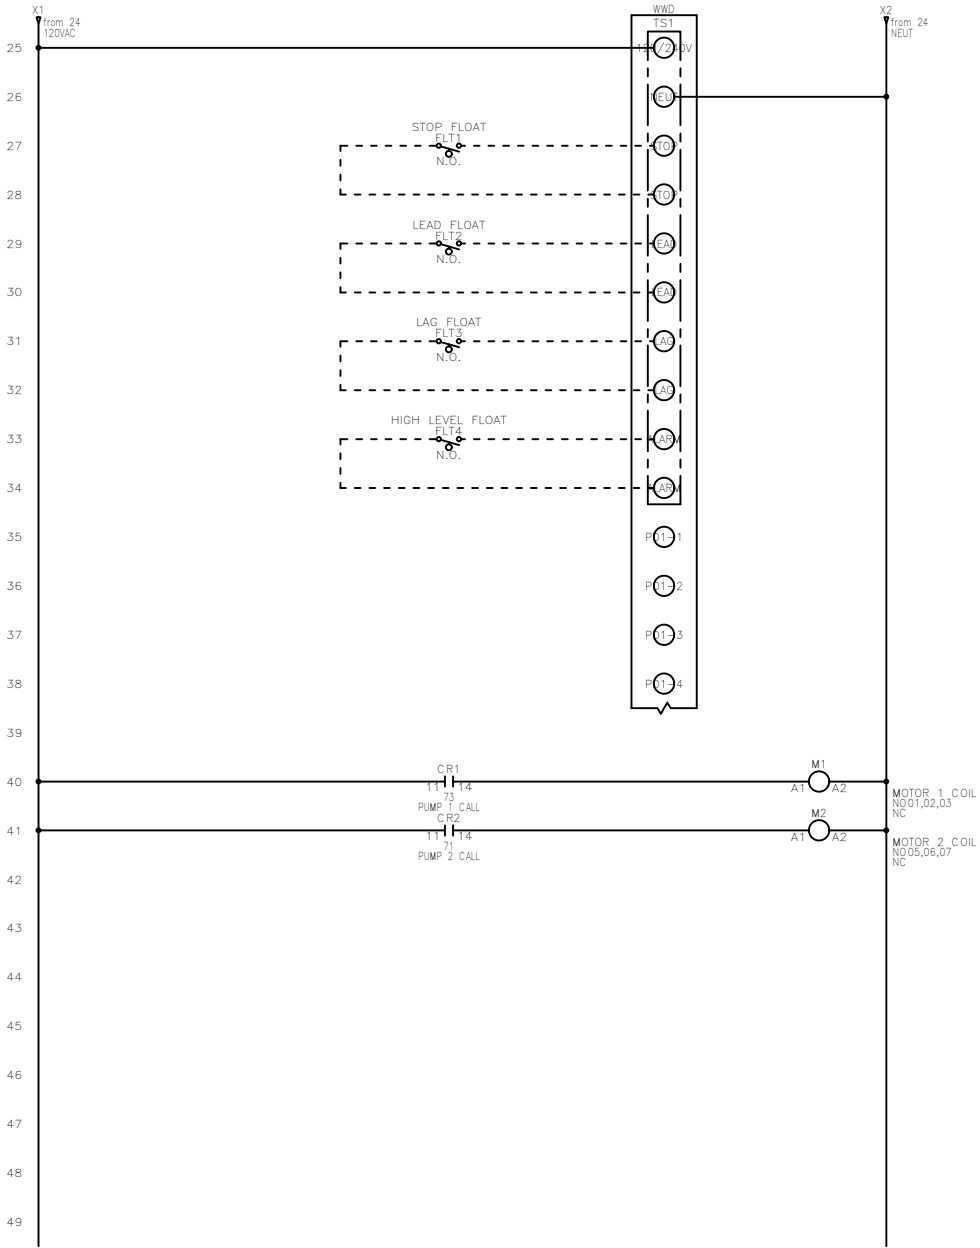


FNAME: WD3P-4-(3031-3033)

REVDATE: 0621

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	AUTHOR
	D	UPDATED WWD BOARD REVISION	6/3/21	AO

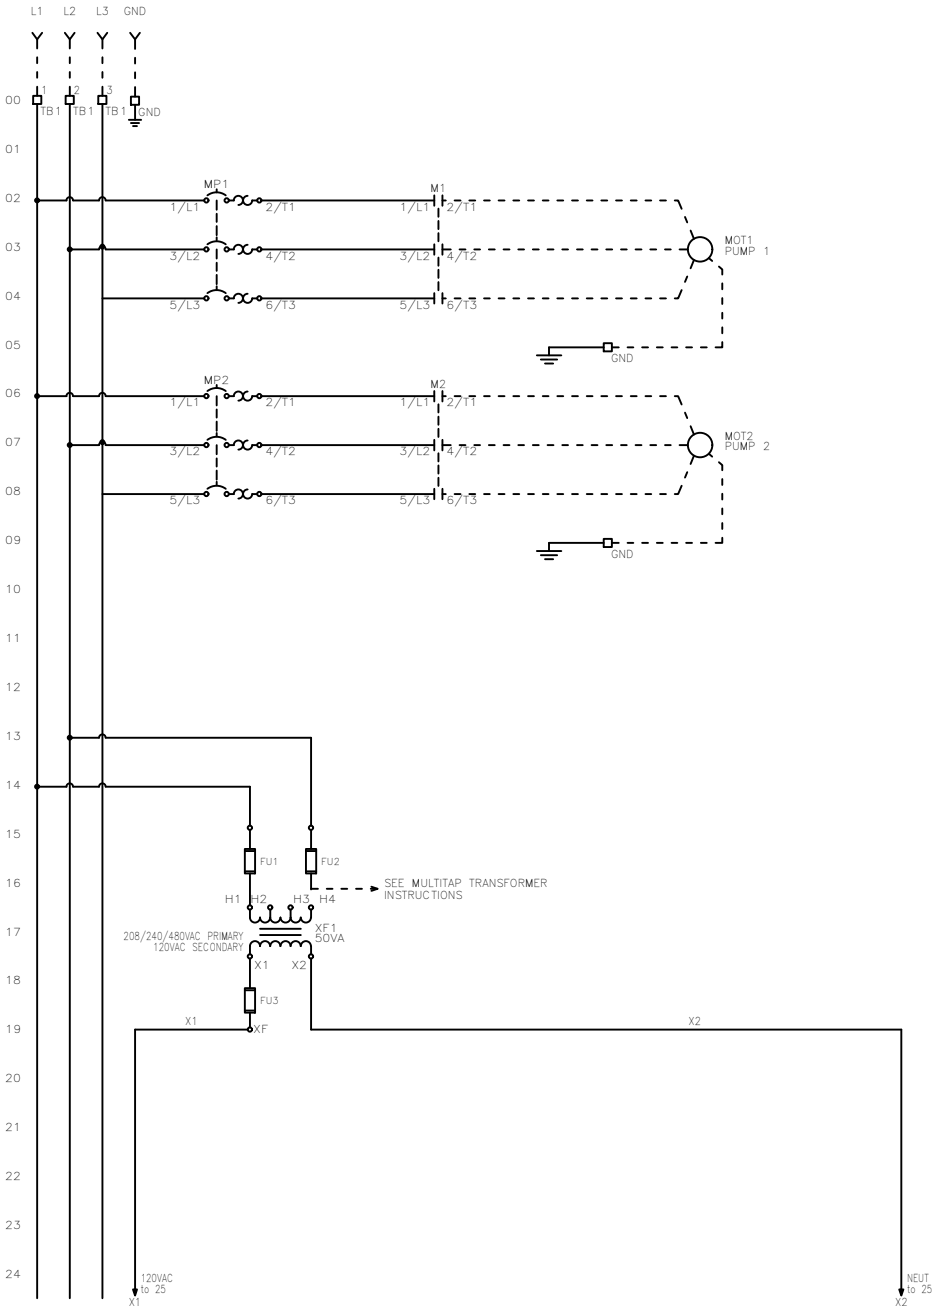

MULTI-TAP TRANSFORMER:

CONNECT FACTORY TAGGED WIRES TO APPROPRIATE TRANSFORMER VOLTAGE TAP. SEE BELOW FOR CONNECTIONS:

FOR 208V OPERATION, CONNECT TO FUSE INPUT HF & TO TRANSFORMER TAP H2.

FOR 240V OPERATION, CONNECT TO FUSE INPUT HF & TO TRANSFORMER TAP H3.

FOR 480V OPERATION, CONNECT TO FUSE INPUT HF & TO TRANSFORMER TAP H4.

----- DASHED LINE INDICATES FIELD WIRING.

USE COPPER CONDUCTORS ONLY.

TEMPERATURE RATING OF CONDUCTORS IS TO BE: 60°C (140°F) FOR UNDER 100A. 75°C (167°F) FOR OVER 100A.

BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

FIELD WIRING TORQUE SPECS.	
TERMINAL BLOCK UT 2,5	5 IN-LB
TERMINAL BLOCK UT 4	7 IN-LB
TERMINAL BLOCK UT 6	15 IN-LB
TERMINAL BLOCK UT 10	15 IN-LB
TERMINAL BLOCK UT 16	25 IN-LB
TERMINAL BLOCK UT 35	30 IN-LB
TS1, TS2, J1, J2 & J3 PCB	9 IN-LB
TRANSFORMER H1F, H2F & H3F	15 IN-LB
TRANSFORMER H1, H2 & H3	10 IN-LB
DS1 VLS3P63-125 R2	45 IN-LB
DS1 LK4JU3CN 100A	36 IN-LB
DS1 LK4MU3N 200A	200 IN-LB

DRAWN BY: AO

APPROVED BY: KM

DATE: 1/13/20

DATE: 1/13/20

THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.





TITLE: WD3P-4-(3031-3033) CONTROL SCHEMATIC

SIZE B	DWG NO. 1347	PART NO. WD3P-4-(3031-3033)	REV D
SCALE NONE		SHEET 1 OF 2	

FNAME: WD3P-4-(3031-3033)

REVDATE: 0621

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	AUTHOR
	D	UPDATED WWD BOARD REVISION	6/3/21	AO

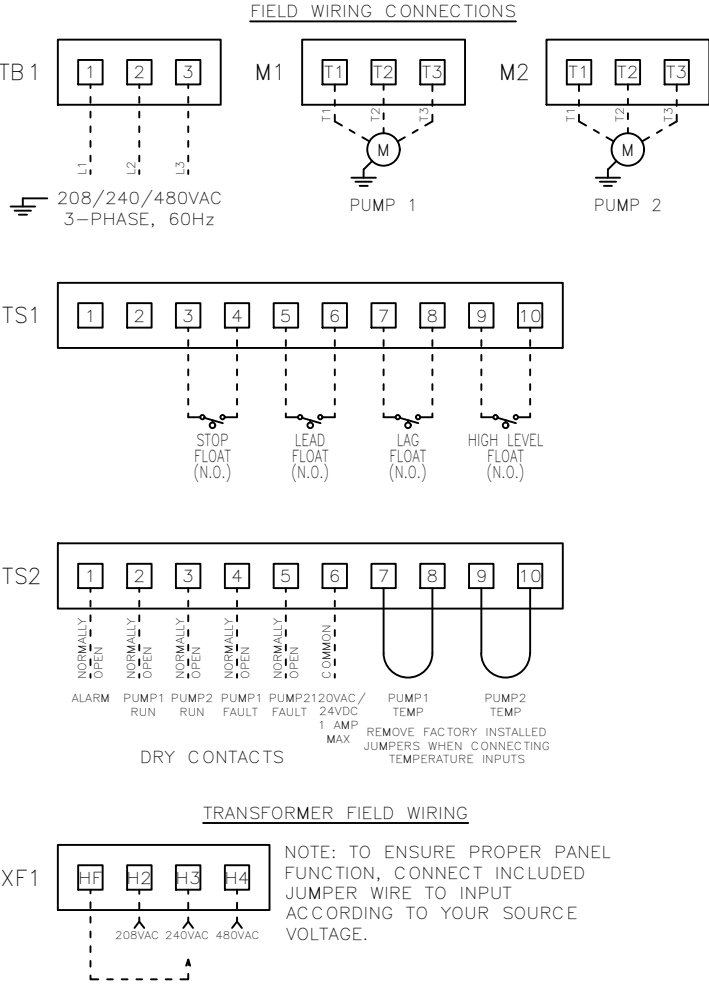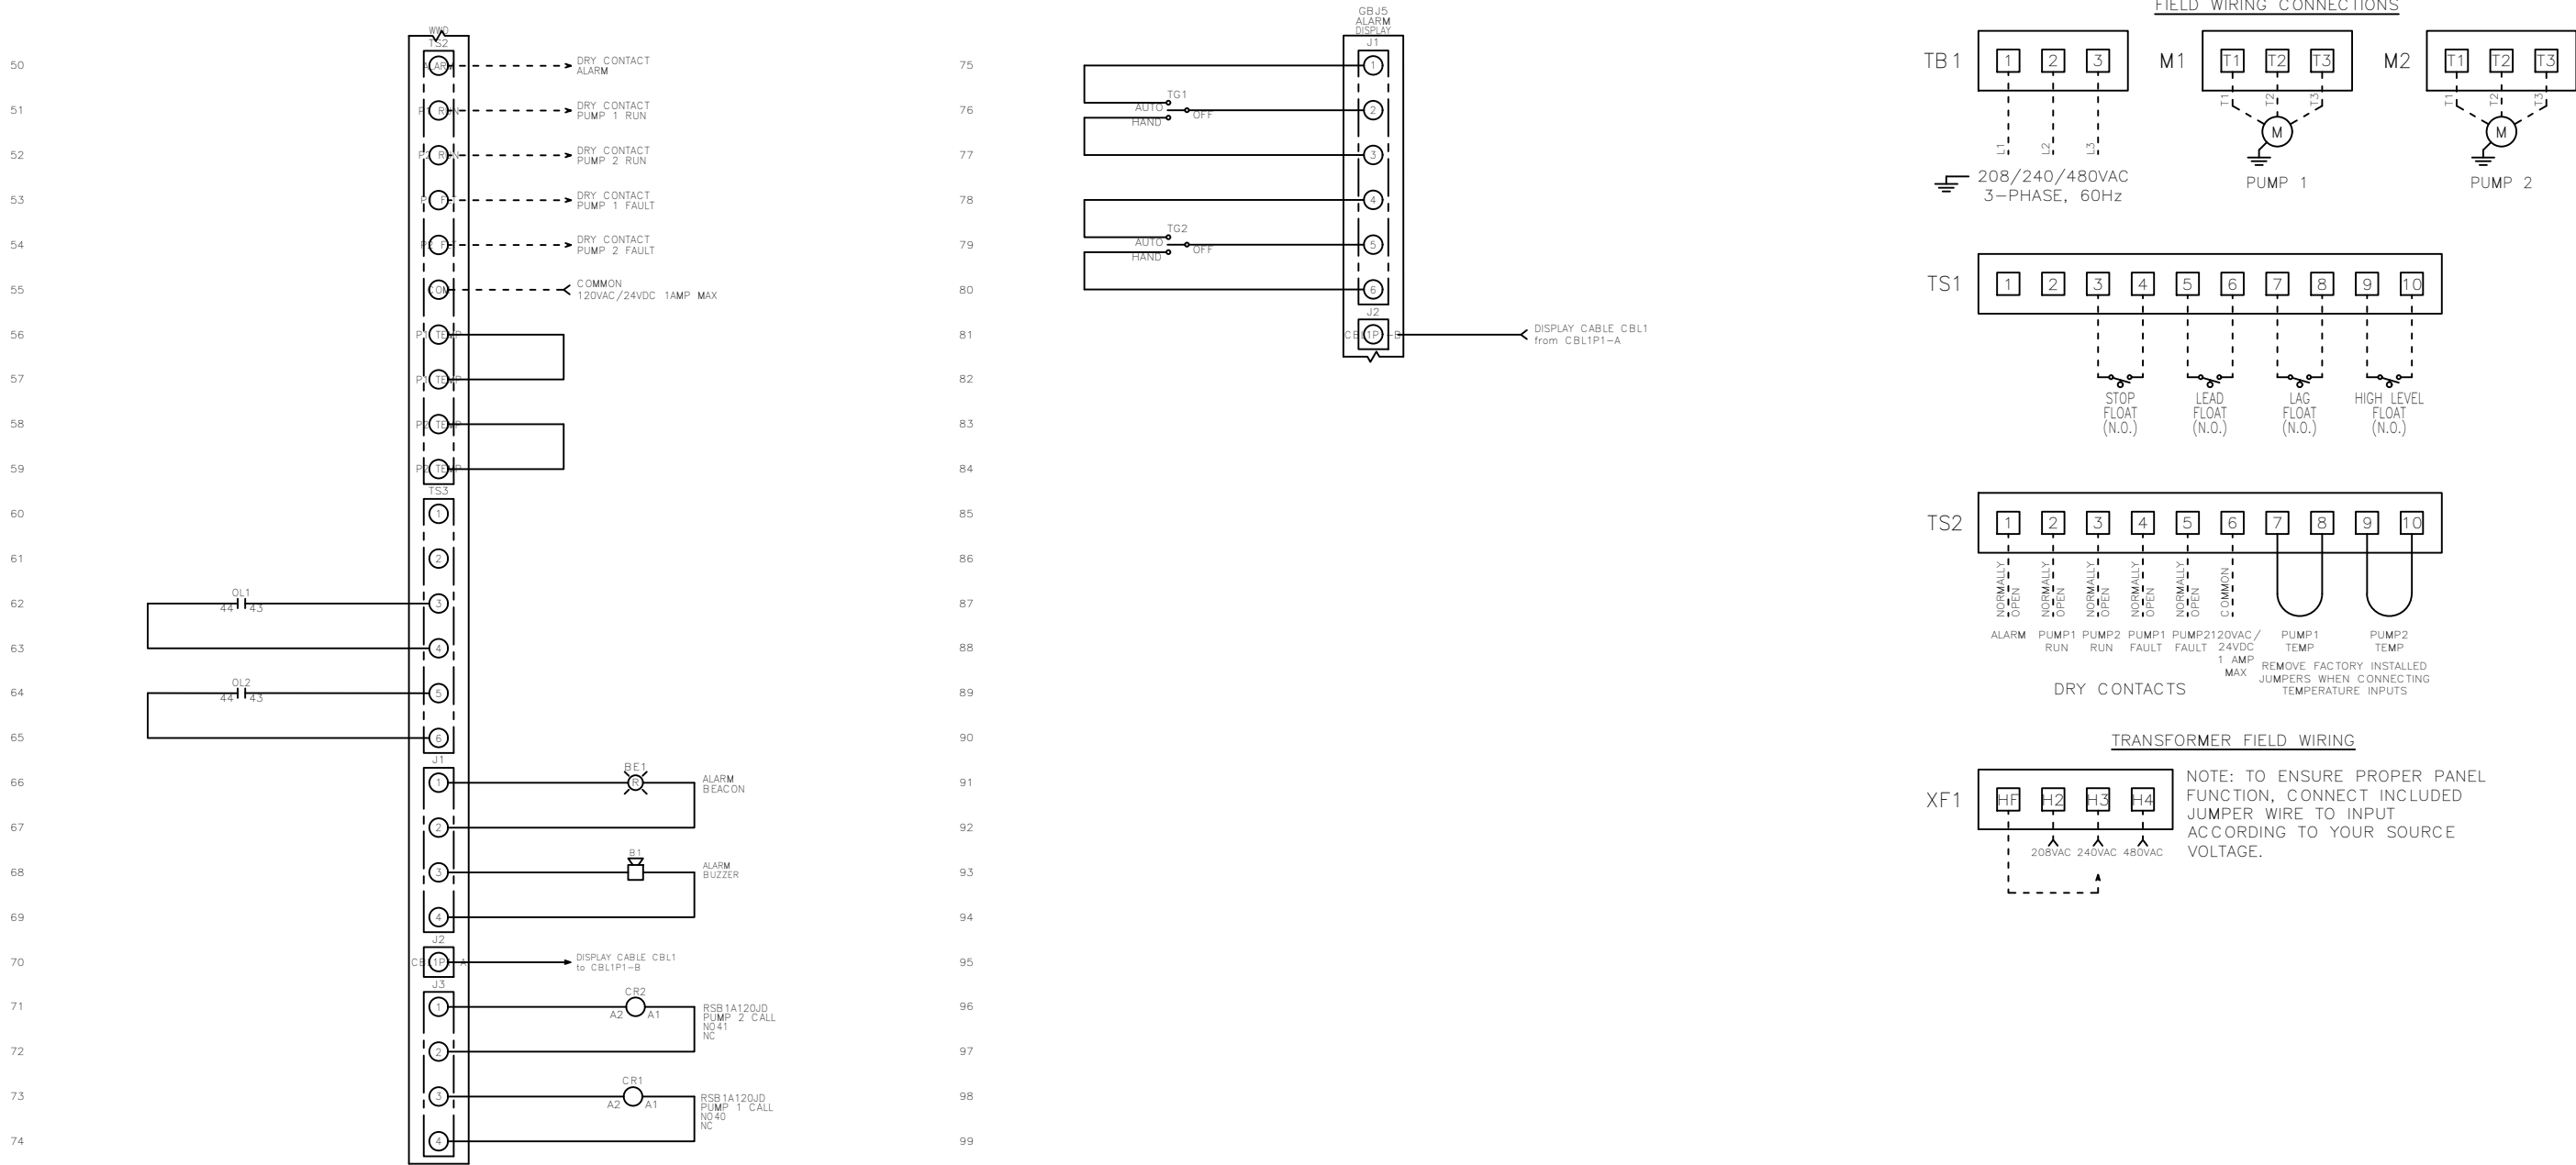

MULTI-TAP TRANSFORMER:

CONNECT FACTORY TAGGED WIRES TO APPROPRIATE TRANSFORMER VOLTAGE TAP. SEE BELOW FOR CONNECTIONS:

FOR 208V OPERATION, CONNECT TO FUSE INPUT HF & TO TRANSFORMER TAP H2.

FOR 240V OPERATION, CONNECT TO FUSE INPUT HF & TO TRANSFORMER TAP H3.

FOR 480V OPERATION, CONNECT TO FUSE INPUT HF & TO TRANSFORMER TAP H4.

----- DASHED LINE INDICATES FIELD WIRING.

USE COPPER CONDUCTORS ONLY.

TEMPERATURE RATING OF CONDUCTORS IS TO BE: 60°C (140°F) FOR UNDER 100A. 75°C (167°F) FOR OVER 100A.

BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

FIELD WIRING TORQUE SPECS.		DRAWN BY: AO	DATE: 1/13/20				
TERMINAL BLOCK UT 2,5	5 IN-LB	APPROVED BY: KM	DATE: 1/13/20	TITLE: WD3P-4-(3031-3033) CONTROL SCHEMATIC			
TERMINAL BLOCK UT 4	7 IN-LB						
TERMINAL BLOCK UT 6	15 IN-LB	THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.		SIZE	DWG NO.	PART NO.	REV
TERMINAL BLOCK UT 10	15 IN-LB			B	1347	WD3P-4-(3031-3033)	D
TERMINAL BLOCK UT 16	25 IN-LB			SCALE		SHEET	
TERMINAL BLOCK UT 35	30 IN-LB			NONE		2 OF 2	
TS1, TS2, J1, J2 & J3 PCB	9 IN-LB						
TRANSFORMER H1F, H2F & H3F	15 IN-LB						
TRANSFORMER H1, H2 & H3	10 IN-LB						
DS1 VLS3P63-125 R2	45 IN-LB						
DS1 LK4JU3CN 100A	36 IN-LB						
DS1 LK4MU3N 200A	200 IN-LB						